

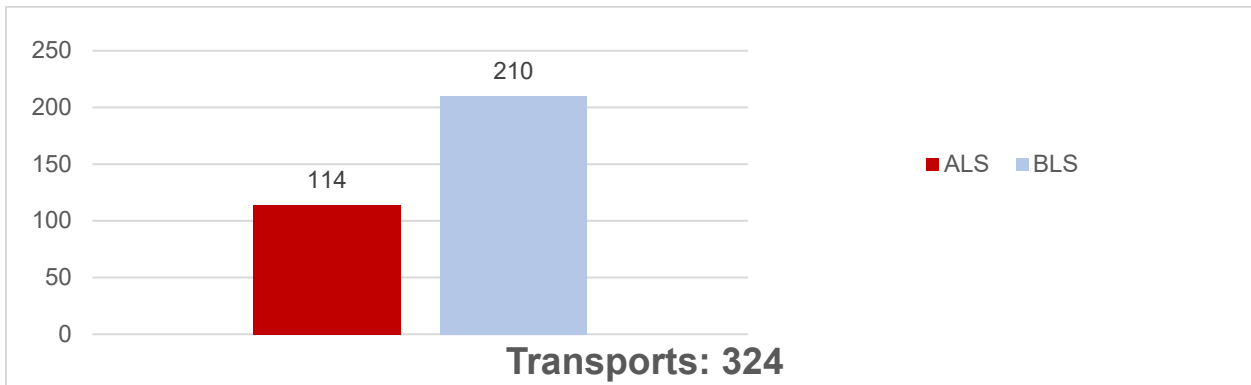


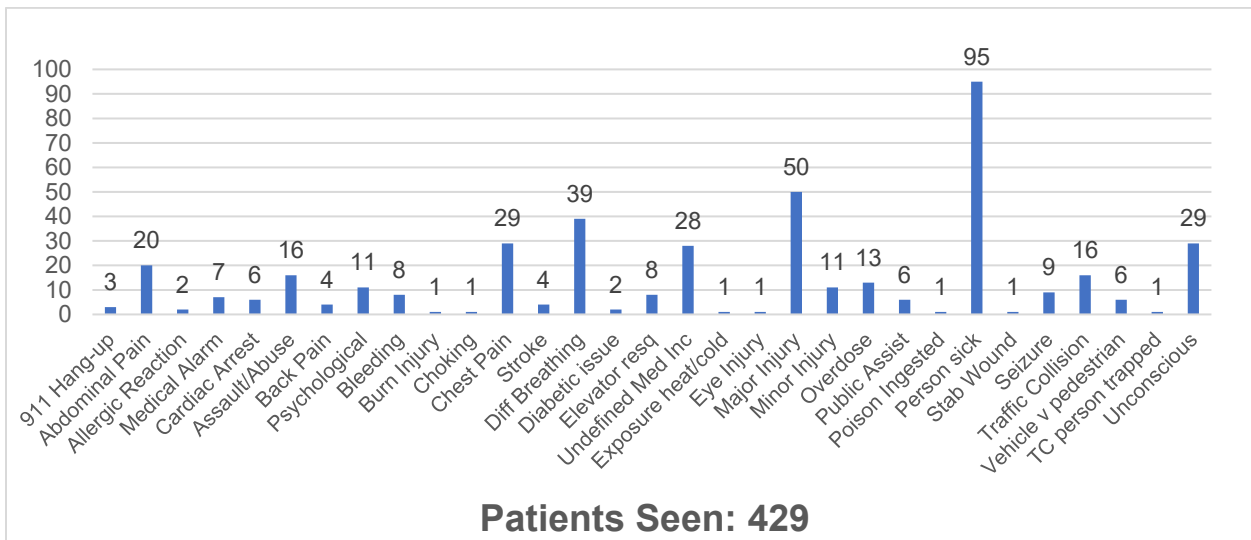

FIRE ACTIVITY REPORT

City of West Hollywood | July 2025

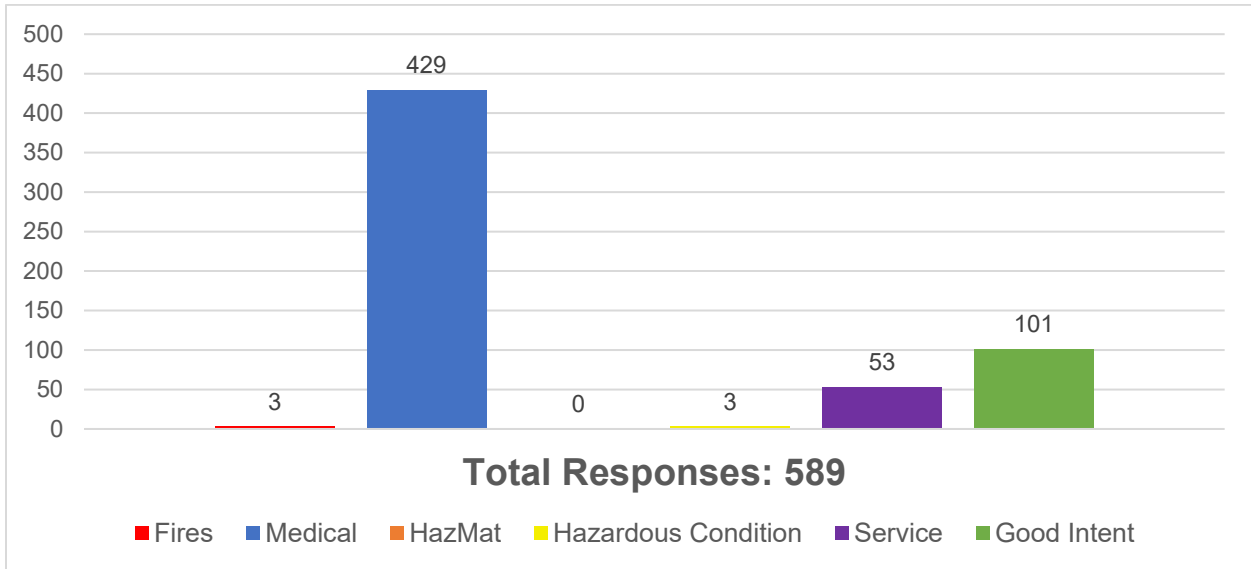

Advanced Life Support (ALS) Transports: transported to hospital in ambulance with paramedic on board;

Basic Life Support (BLS) Transports: transported without paramedic on board



FIRE ACTIVITY REPORT

City of West Hollywood | July 2025

FIRE INCIDENTS:

DATE	TYPE	ADDRESS	NOTES	LOSS
07/09/25	Structure Fire	1201 LA BREA	Commercial Building fire, Confirmed PEH to start structural interior. Fire was limited to room of origin with severe heat and smoke damage to the building interior.	Property: \$75,000.00 Contents: \$25,000.00
07/16/25	Rubbish Fire	913 FAIRFAX	Dumpster or other outside trash receptacle fire	Property: \$500.00 Contents: \$0.00
07/25/25	Rubbish Fire	8801 SUNSET	Dumpster or other outside trash receptacle fire	
			TOTAL:	Property: \$75,500.00 Contents: \$25,000.00




OTHER INCIDENTS:

DATE	TYPE	ADDRESS	NOTES	LOSS
07/14/25	Haz Cond	1145 OGDEN	Gas leak (natural gas or LPG)	
07/21/25	Haz Cond	8914 CYNTHIA	Gas leak (natural gas or LPG)	
07/22/25	Haz Cond	8439 SUNSET	Gas leak (natural gas or LPG)	



FIRE ACTIVITY REPORT

City of West Hollywood | July 2024

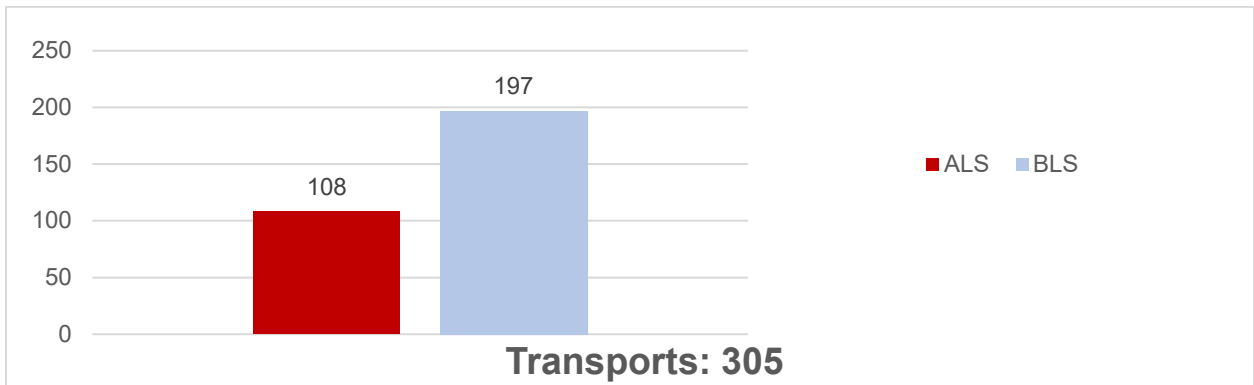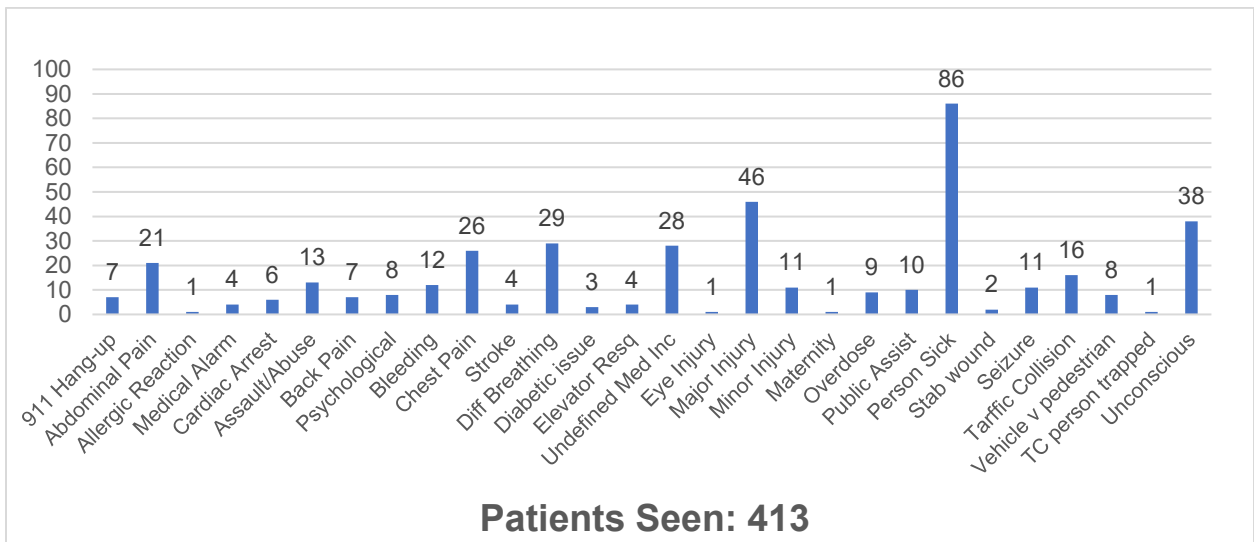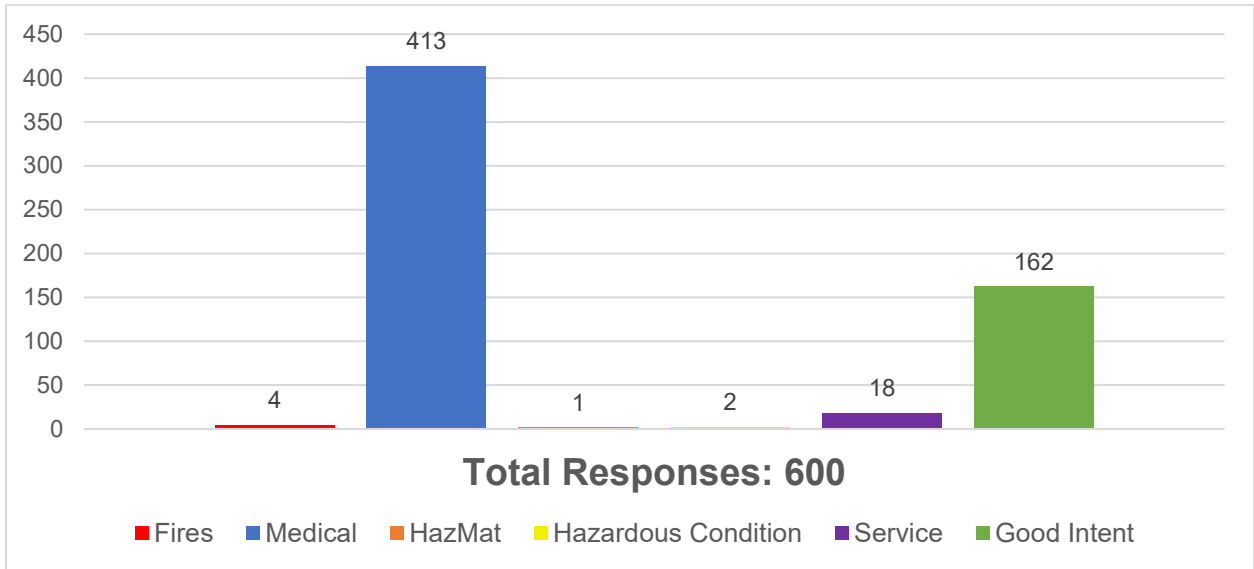

Advanced Life Support (ALS) Transports: transported to hospital in ambulance with paramedic on board;

Basic Life Support (BLS) Transports: transported without paramedic on board



FIRE ACTIVITY REPORT

City of West Hollywood | July 2024

FIRE INCIDENTS:

DATE	TYPE	ADDRESS	NOTES	LOSS
07/06/24	Rubbish Fire	7100 SANTA MONICA	Rags/clothing set on fire in concrete stairwell. Sprinkler activated in stairwell containing fire to rags.	
07/06/24	Rubbish Fire	FAIRFAX & WILLOUGHBY	Trash or rubbish fire, contained	
07/17/24	Cooking Fire	1227 HORN Ave	E7 arrived to find an apartment with burning contents on the stove. Fire was extinguished by resident. Apartment was ventilated utilizing positive pressure ventilation.	
07/21/24	Structure Fire	841 WESTMOUNT Dr	E7 reported a 2-story apartment complex with nothing showing. Upon further investigation within unit, it was reported that there was an electrical fire in a ceiling lighting fixture. It was then determined that the fire started in a power strip connected to an electrical outlet in the ceiling. Prior to FD arrival the residents poured water on the fire to stop fire spread.	
TOTAL:				Property: \$0.00 Contents: \$0.00

OTHER INCIDENTS:

DATE	TYPE	ADDRESS	NOTES	LOSS
07/13/24	Haz Cond	937 FAIRFAX Ave	Gas leak (natural gas or LPG)	
07/15/24	Haz Cond	7316 SANTA MONICA	Carbon monoxide incident. Small amount of CO from stove top burner that was left open all night. Levels went down after FD opened windows and vented the unit	
07/26/24	HazMat	SANTA MONICA & KINGS Rd	Arrived to find a semi-truck that was hauling vehicles hit a light standard which punctured its left drivers side saddle tank. Upon arrival, LF8 investigated and found approximately 20 gallons of diesel fuel that had already leaked out of the tank and onto the street. Fuel had not gotten into any storm drains. No smoke or fire. Health HazMat requested, and fuel spill mitigated with absorbent provided by West Hollywood Public Works.	